


2 1/2" BRASS NSFT
DISCHARGE WITH CAP
AND CHAIN

FLUSH HYDRANT BOX TO BE SUPPLIED BY
CONTRACTOR (POLYMER CONCRETE AND FIBER
REINFORCED POLYESTER - PERMANENT PURPLE COLOR)

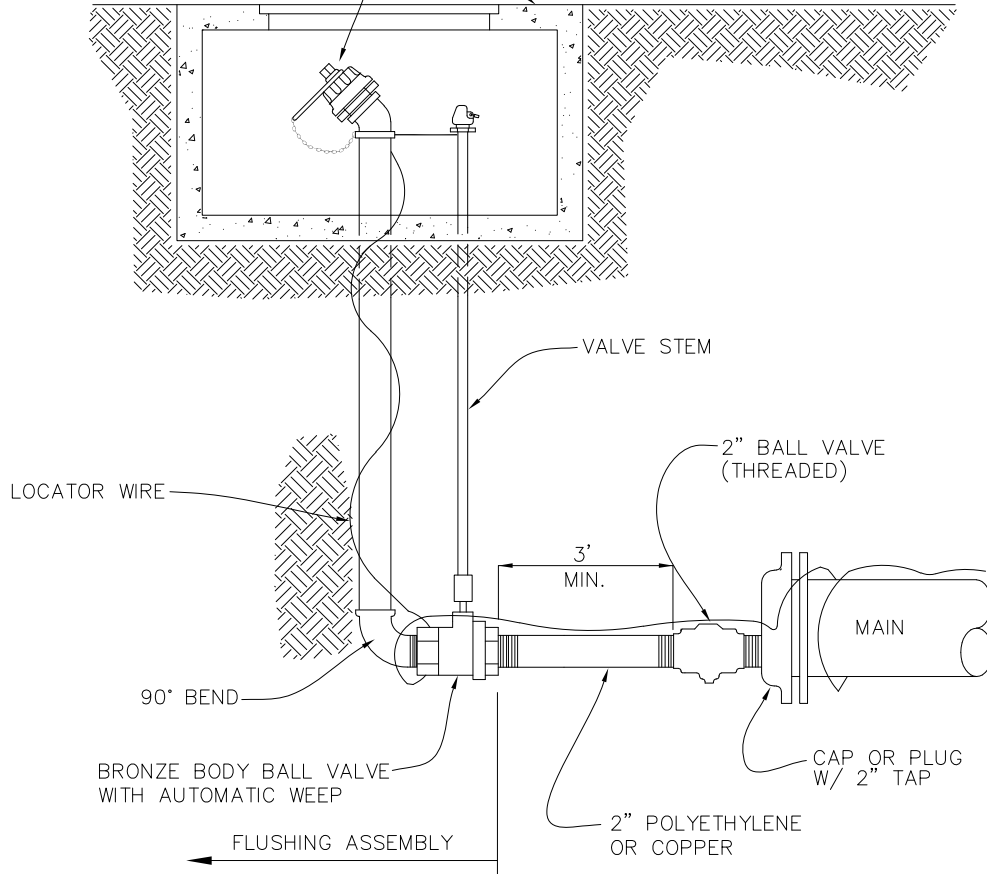

NOTES:

1. FLUSHING HYDRANT ASSEMBLY SHALL BE GIL INDUSTRIES, AQUARIUS ONE-O-ONE 2" POST FLUSHING HIDDEN HYDRANT.
2. MAIN TO BE RESTRAINED FOR TWO FULL LENGTHS.
3. LID SHALL BE LOCKABLE AND MARKED "REUSE"

IQ WATER FLUSHING HYDRANT

DSGN.
DRW. MES
CK. ML



CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED
AUGUST 2016

DRAWING NUMBER

IQ 04