


PLEASE REFER TO WRITTEN SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS

NOTE: THE ELECTRICAL CONTROL PANEL SHALL BE LOCATED SO AS NOT TO CONFLICT WITH THE EMERGENCY PUMP OUT PORT

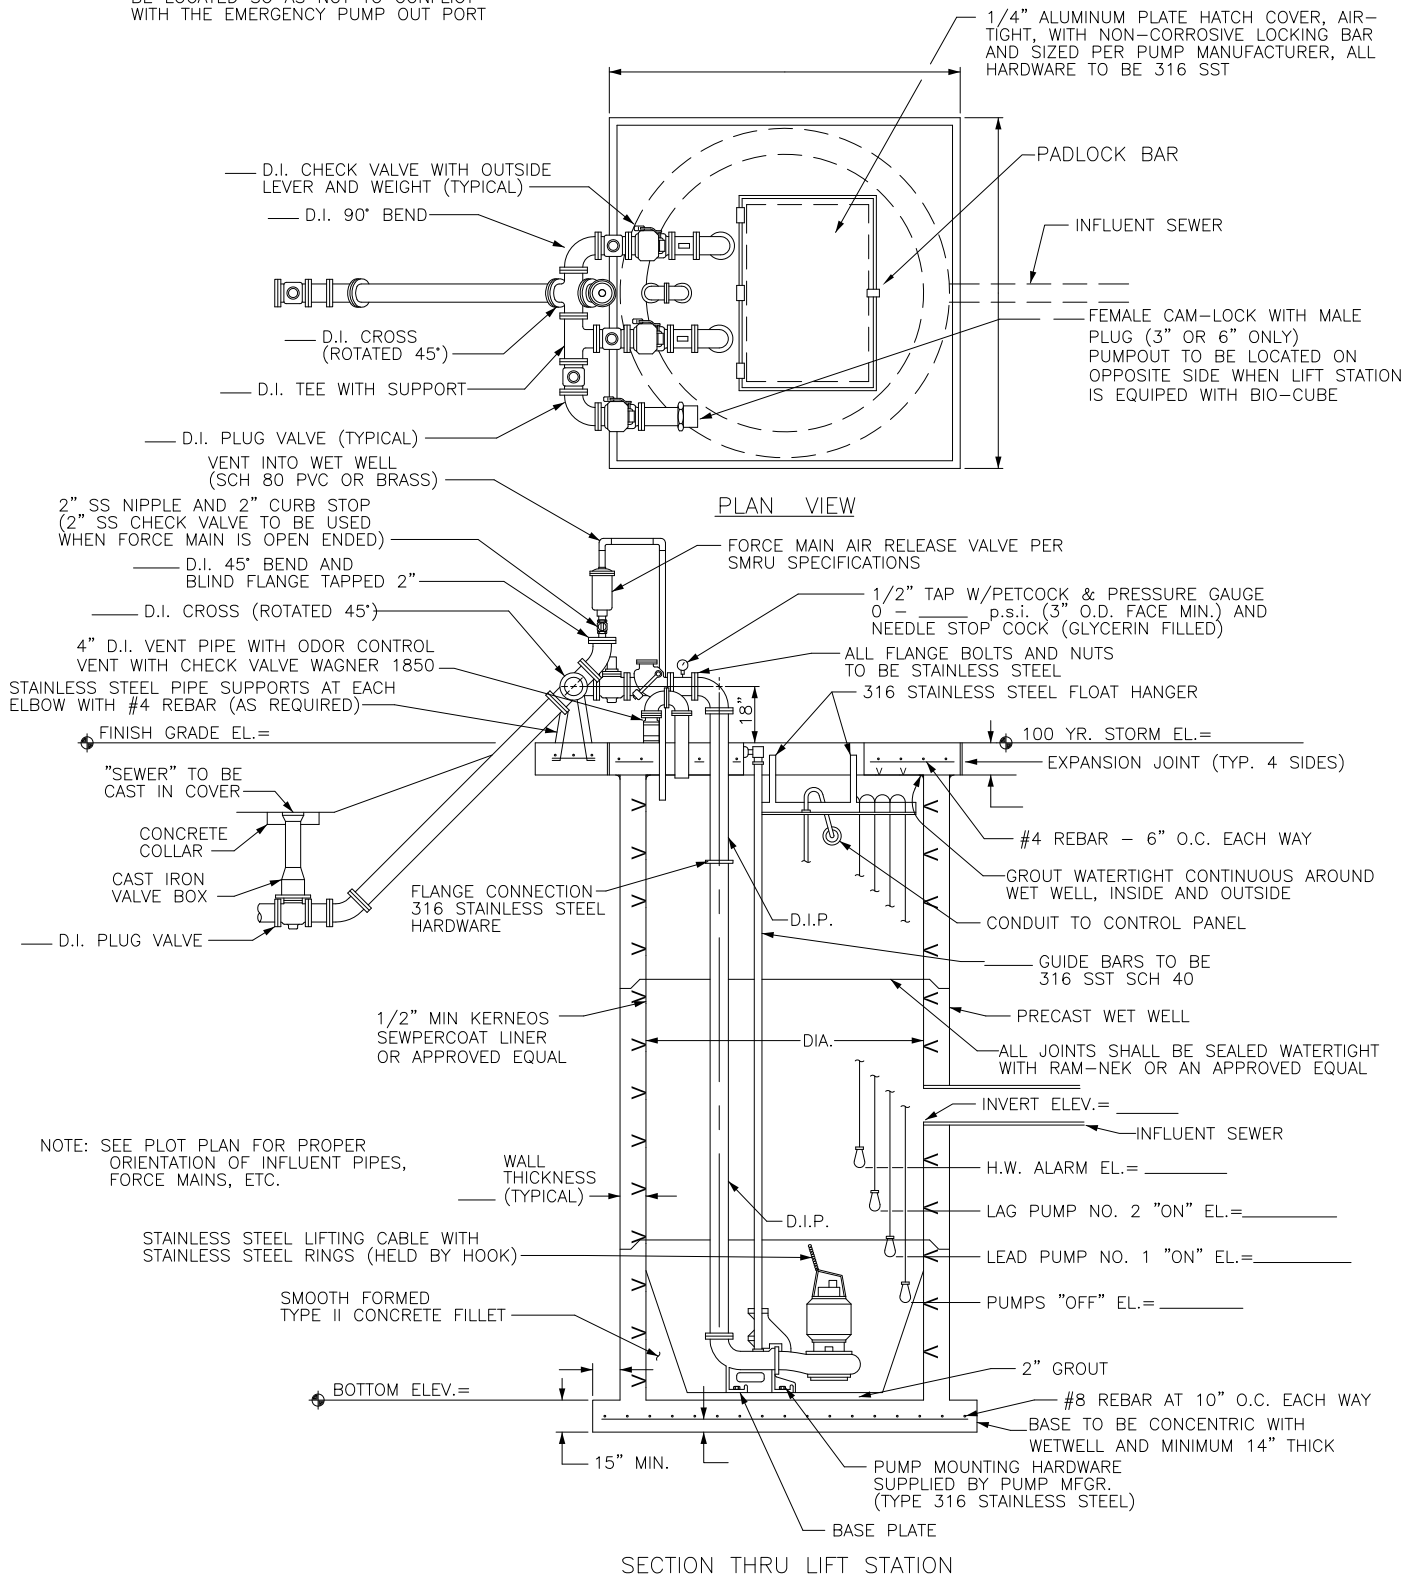

DUPLEX LIFT STATION DETAIL

DSGN.

DRW. MS

CK. ML



SOUTH MARTIN REGIONAL UTILITY (SMRU)

CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED

June 2016

DRAWING NUMBER

LS 2