
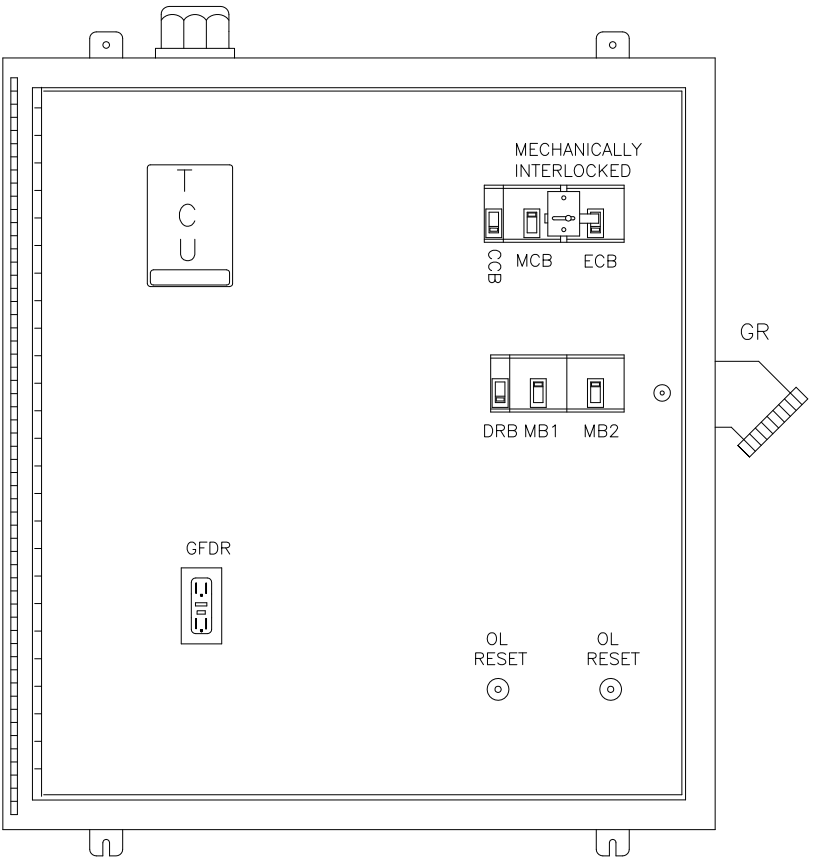
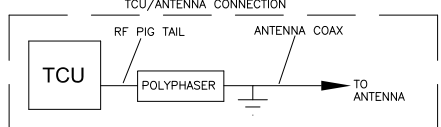
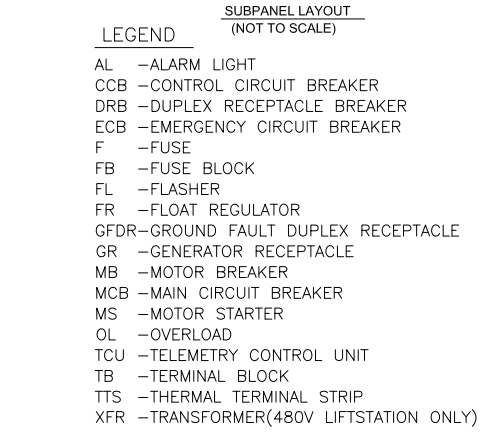


SEE NOTE 14

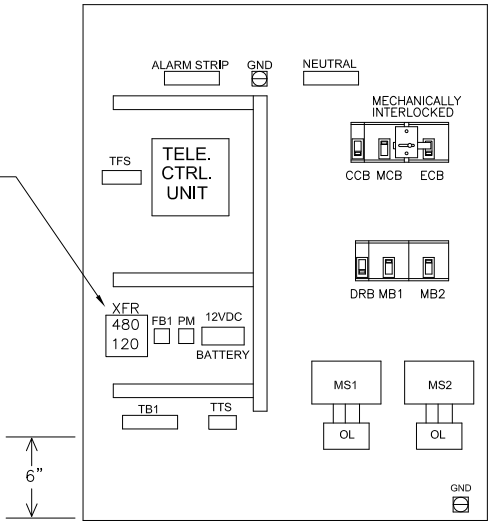

- NOTES: (PLEASE REFER TO WRITTEN SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS)
1. TELEMETRY CONTROL UNIT SUPPLIED WITH PANEL. (ANTENNA SUPPLIED BY OTHERS)
 2. MINIMUM ENCLOSURE 42x30x10.
 3. LEAVE 6" SPACE AT BOTTOM OF ENCLOSURE.
 4. U.L. LABEL, SERVICE ENTRANCE RATED.
 5. CONTROL WIRE TO BE AWG 14 MINIMUM.
 6. LAMINATED SCHEMATIC TO BE 11X17.
 7. PROVIDE ADEQUATE SPACE FOR 12V DC BATTERY REPLACEMENT.
 8. OUTER DOOR REMOVED TO SHOW DEAD FRONT LAYOUT.
 9. NEMA TYPE 12M 316 S.S. ENCLOSURE WITH CONTINUOUS HINGE.
 10. INCLUDES 3 PT. LATCH. (NOT SHOWN) AND DOOR STOPS ON OUTER DOOR AND DEAD FRONT.
 11. ALL HARDWARE TYPE 316 S.S.
 12. TYPICAL, ACTUAL LAYOUT MAY VARY WITH HORSEPOWER.
 13. MOUNT RECEPTACLE IN GANG BOX TO PREVENT EXPOSURE OF LIVE CONDUCTORS AND CONTACTS.
 14. 480/120 TRANSFORMER ONLY REQUIRED IN CONTROL PANELS WITH 480VAC SERVICE.

FLORIDA LICENSED PROFESSIONAL ENGINEER TO REVIEW AND MODIFY ELECTRICAL DESIGN AS REQUIRED TO ACCOMPLISH CONSTRUCTION IN ACCORDANCE WITH APPLICABLE CODES AND STANDARDS

LIFT STATION CONTROL PANEL LAYOUT

DSGN.	
DRW.	MS
CK.	ML



CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED	June 2016
DRAWING NUMBER	LS 9