

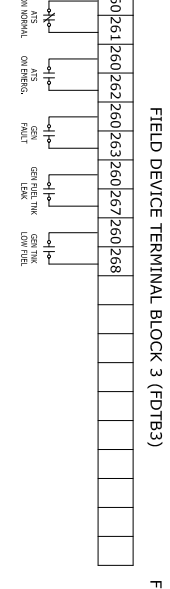
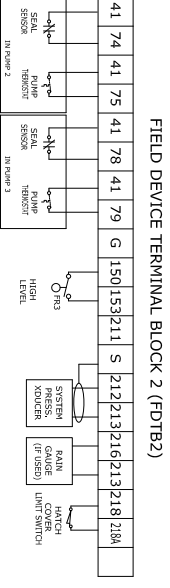


NOTE:
ENCLOSURE SHALL BE NEMA 3R 316 STAINLESS STEEL 60" H X 72" W X 12" D

TRIPLEX CONTROL PANEL LAYOUT
FOR LIFT STATION WITH STANDBY GENERATOR

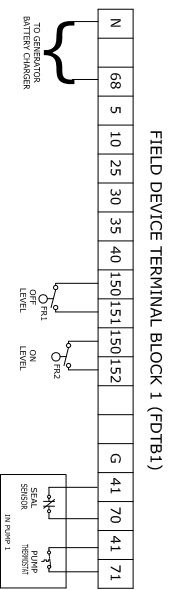

FLORIDA LICENSED PROFESSIONAL ENGINEER TO REVIEW AND APPROVE ELECTRICAL DESIGN AS REQUIRED TO ACCOMPLISH CONSTRUCTION IN ACCORDANCE WITH APPLICABLE CODES AND STANDARDS.

PLAN STATUS

DATE	DESCRIPTION

M.E.S. M.L.
DRAWN CHKD
SCALE NTS

DATE: JUNE, 2016

SHEET LS 14

TRIPLEX STATION CONTROL
PANEL LAYOUT
CONSTRUCTION STANDARDS AND DETAILS
MARTIN COUNTY FLORIDA

SOUTH MARTIN REGIONAL UTILITY
9000 SE Athena Street
Hobe Sound, FL 33455
Phone: (772) 546-2511
www.southmartinregionalutility.com

