


5'x 5'x 6" THICK
CONCRETE COLLAR
WITH WIRE MESH
REINFORCING.
OR
5'x 5'x 8" COLLAR
WITHOUT REINFORCING.

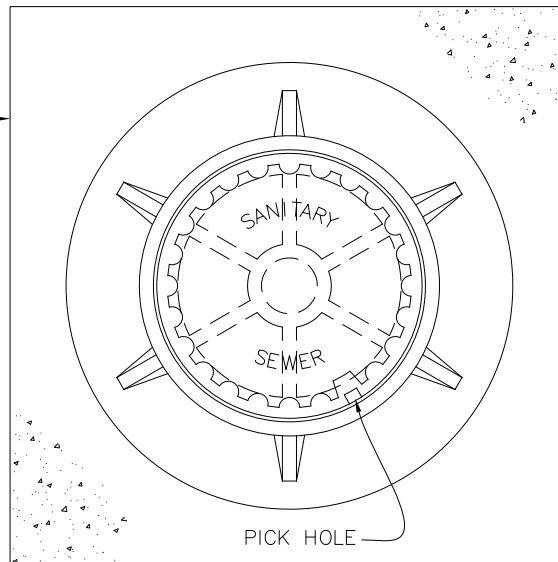

NOTES:

1. COLLAR IS REQUIRED ONLY WHEN MANHOLE IS OUT OF PAVEMENT.
2. MINIMUM WEIGHTS: COVER - 165 LBS., FRAME - 240 LBS.
3. FRAME AND COVER SHALL BE U.S. FOUNDRY NO. 420A OR VULCAN NO. 44 OR APPROVED EQUAL.
4. MANHOLE COVER SHALL HAVE THE WORDS "SANITARY SEWER" CAST IN METAL.
5. MANHOLE COVER SHALL MEET H-20 TRAFFIC LOADING.

SANITARY SEWER MANHOLE FRAME AND COVER

DSGN.

DRW. MES

CK. ML



SOUTH MARTIN REGIONAL UTILITY (SMRU)

CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED
AUGUST 2016

DRAWING NUMBER

SS 08