



WORDS "GREASE TRAP" OR "GREASE INTERCEPTOR" TO BE CAST IN COVER

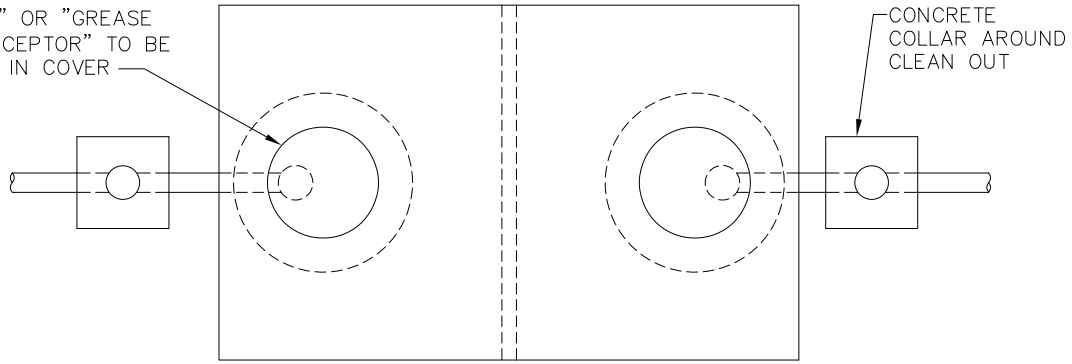

TOP VIEW

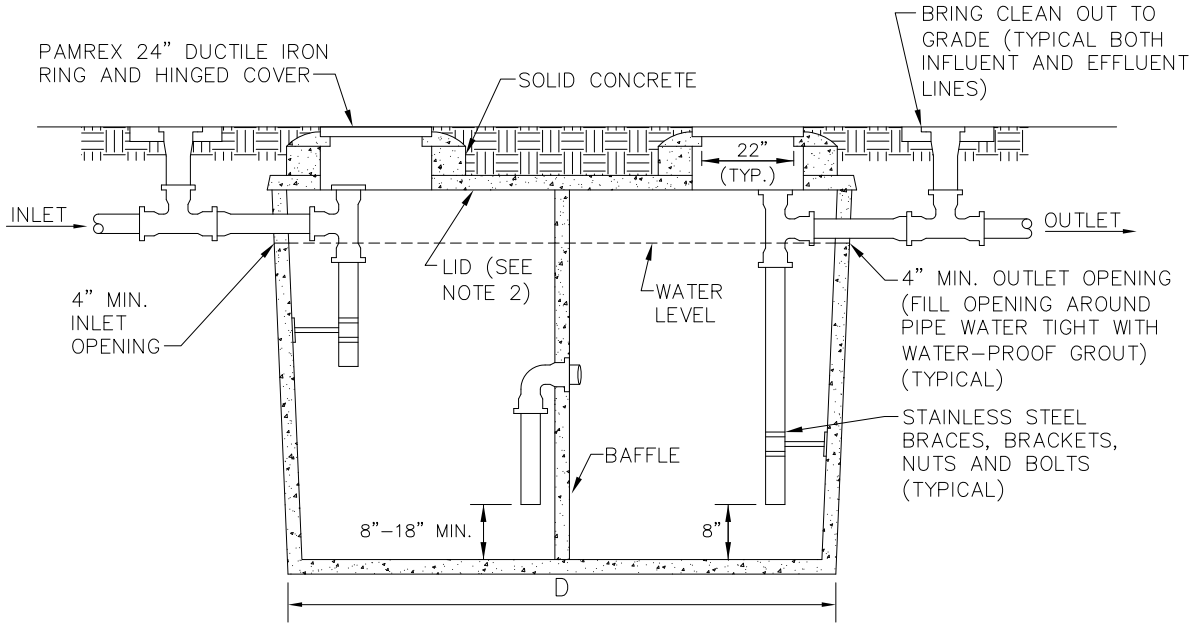

SECTION

NOTES:

1. GREASE TRAPS (SEPTIC TANKS) SHALL BE MANUFACTURED BY FLORIDA SEPTIC INC., SEBRING SEPTIC, AVERETT SEPTIC, OR APPROVED EQUAL STATEMENT: "THIS CONCRETE STRUCTURE MEETS OR EXCEEDS ALL THE REQUIREMENTS FOR GREASE INTERCEPTORS/SEPTIC TANKS AS IN THE FLORIDA ADMINISTRATIVE CODE, CHAPTERS 64E-6.0138D & THE SHOP DRAWINGS (3 COPIES MINIMUM) SHALL THEN BE SIGNED AND SEALED BY THE ENGINEER-OF-RECORD AND FORWARDED TO SMRU FOR APPROVAL.
2. LID TYPES:
  - A) 4" REGULAR LID
  - B) 8" TRAFFIC BEARING LID
3. ALL INTERNAL COMPONENTS WILL BE CONSTRUCTED BY GREASE TRAP INSTALLER.
4. TANK INSPECTIONS WILL OCCUR WITH TANK ABOVE GROUND.
5. PROVIDE ZABEL FILTER FOR SCREENING.
6. BAFFLE SHALL BE INSTALLED 1/2 (ONE HALF) TO 2/3 (TWO THIRDS) 'D'.

## DOUBLE-COMPARTMENT GREASE TRAP AND OIL SEPARATOR

DSGN.	
DRW.	MES
CK.	ML



SOUTH MARTIN REGIONAL UTILITY (SMRU)

### CONSTRUCTION STANDARDS AND DETAILS

DATE APPROVED  
**AUGUST 2016**

DRAWING NUMBER

SS 12